


C:\Users\jenn1\OneDrive\WEDAL-SEG\CT65R.dwg 7/5/2024 4:04:33 PM

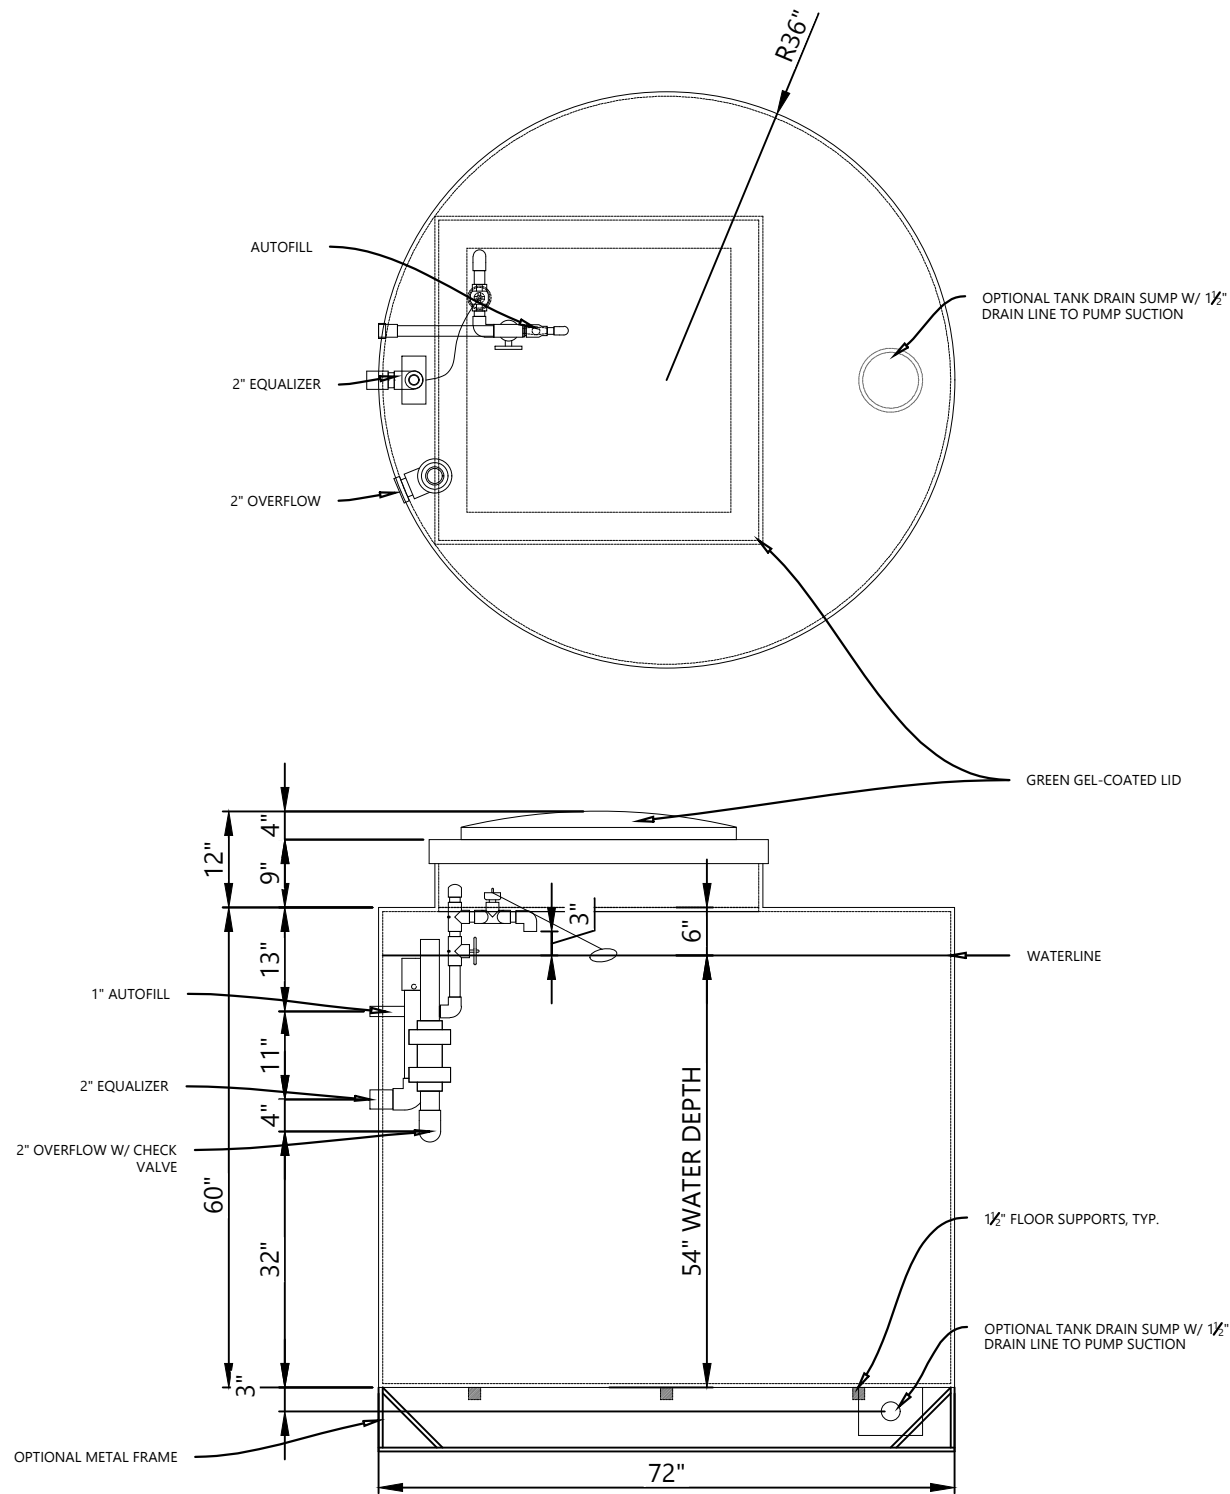

TANK SPECIFICATIONS				
SIZE	CAPACITY (GAL)	VENT	STL. FRAME	SUMP
6' Ø X 5'	FULL: 1,028 6" FREEBOARD: 925	Y / N	Y / N	Y / N
NOTES: ROOF VENT, SUMP/DRAIN & METAL FRAME ARE ALL OPTIONAL. TANKS WILL HAVE REINFORCING RIBS PLACED DURING MANUFACTURING.				

TANK PLUMBING			
LABEL	SIZE	DESCRIPTION	VALVE
A		MAIN DRAIN	CRANK
B	2"	STATIC EQUALIZER	FLOAT
C		GUTTER/SKIMMER	CRANK
D		PUMP SUCTION 1	
F		PUMP SUCTION 2	
F	2"	OVERFLOW	CHECK
G	1"	POTABLE WATER FILL	AUTO & MANUAL
H			
I			
J			

COLLECTOR TANK GENERAL NOTES:

- DRAWINGS COMPLY WITH STATE & LOCAL BUILDING CODES.
- ALL PIPING "NSF-PW" APPROVED. PLUMBING
- PROPORTIONING VALVES ONLY - GATE VALVES ARE PROHIBITED.
- ALL TANKS HAVE COVED CORNERS AND SLOPE TO DRAINS.
- ALL EQUIPMENT IS UL LISTED NSF-50.
- ALL PVC PIPE SUBJECT TO UV EXPOSURE IS TO BE COATED TO PROTECT AGAINST UV DEGRADATION.
- TANK OVERFLOW LINE MUST BE CONNECTED TO APPROVED SEWER SYSTEM IN ACCORDANCE WITH STATE AND LOCAL CODES.



WWW.SEGAQUATICS.COM
MCWSEG@GMAIL.COM
813.431.7063

ALL INFORMATION CONTAINED IN THIS DOCUMENT IS PROPERTY OF SEG, INC AND MAY NOT BE REPRODUCED OR COMMUNICATED WITHOUT PRIOR PERMISSION IN WRITING FROM SEG, INC. ALL DESIGN SPECIFICATIONS & COMPONENTS ARE SUBJECT TO CHANGE WITHOUT NOTICE. PLEASE CONSULT OUR WEBSITE FOR UP TO DATE ENGINEERING DRAWINGS.

DATE	Jul. 5, 26
SCALE	1/2" = 1'-0"
REVISION	A
PROJECT	
CONTRACTOR	
LOCATION	

SHEET TITLE
CT65R